


Wall construction to achieve minimum U-value of 0.35 W/m² K
Ensure that steelwork outriggers are wrapped with insulation to reduce cold bridge.
Stated calculation results are dependent on components being as shown

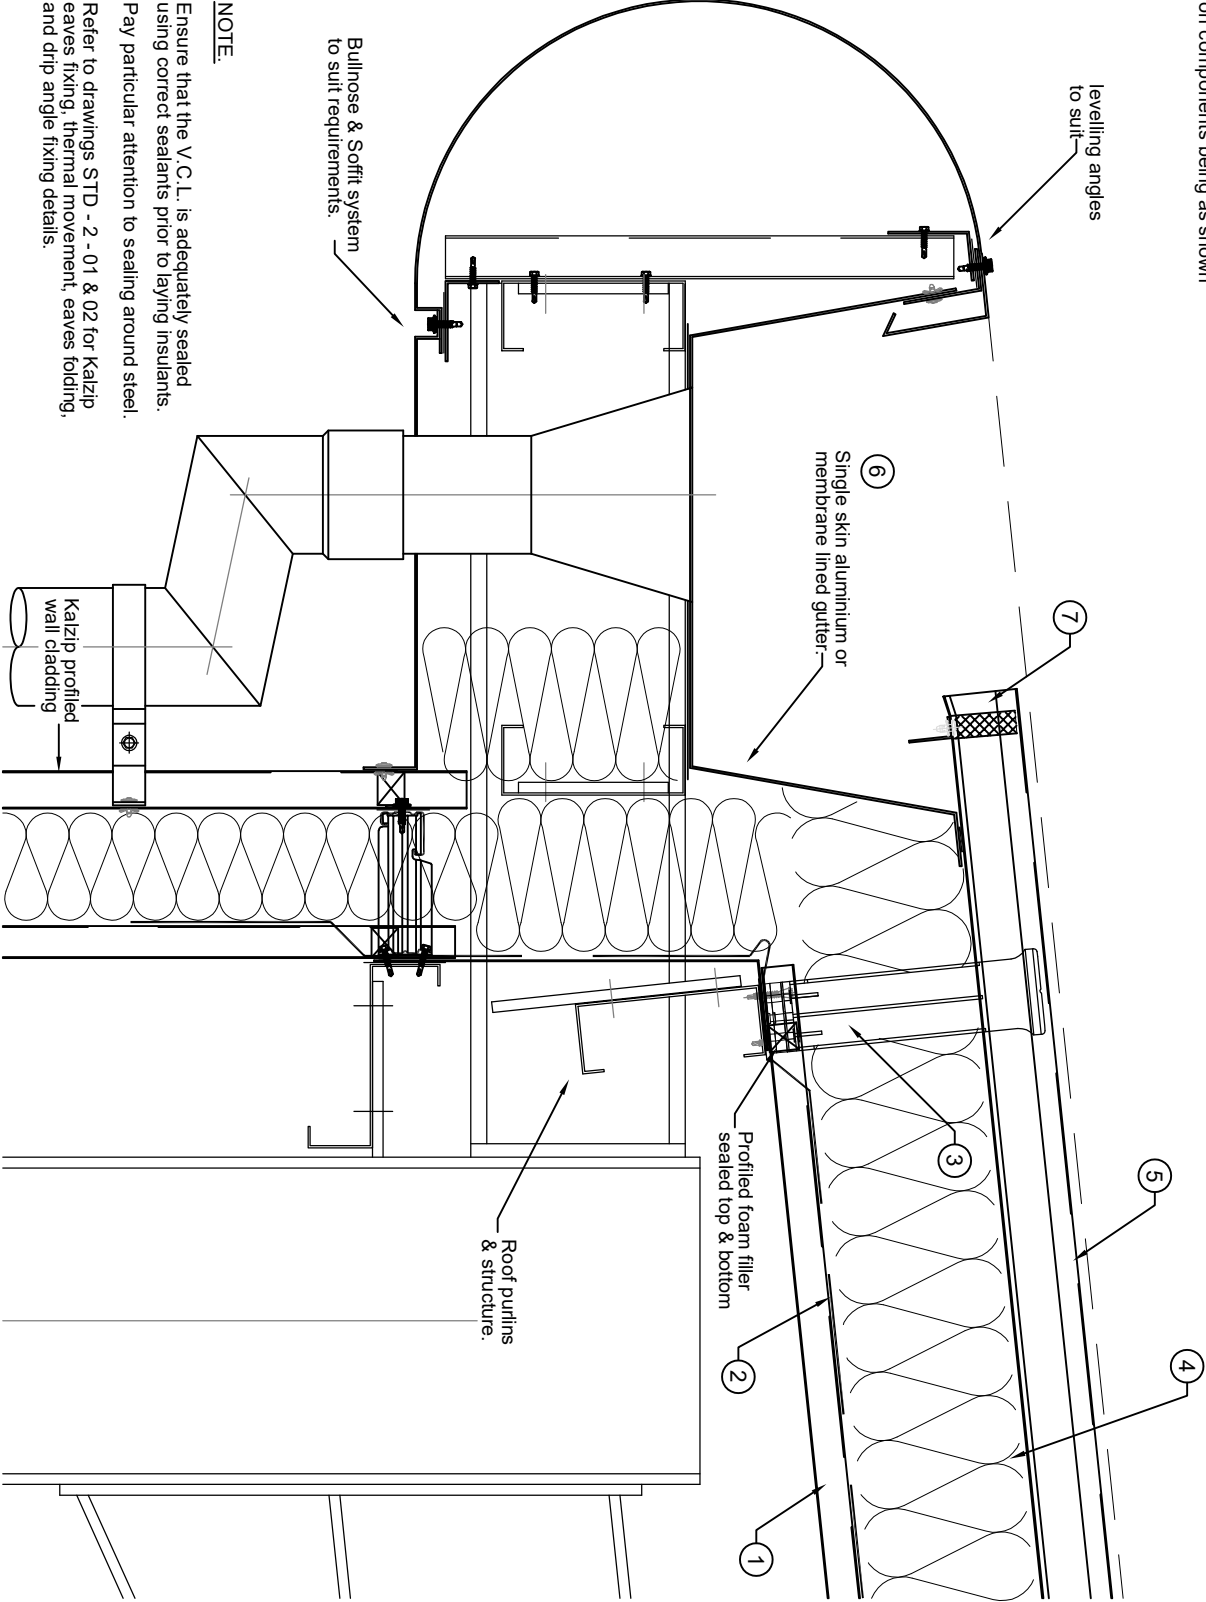

NOTE:

Ensure that the V.C.L. is adequately sealed using correct sealants prior to laying insulants. Pay particular attention to sealing around steel. Refer to drawings STD - 2 - 01 & 02 for Kaizip eaves fixing, thermal movement, eaves folding, and drip angle fixing details.

Notes

- ① **Kaizip LINER SHEET**
Kaizip Liner TR 35/2005 (Finish Colour Etc TBC)
- ② **Kaizip VAPOUR CONTROL LAYER (V.C.L)**
Kaizip VCL sealed at laps with Kaizip sealant tape
- ③ **HALTER CLIPS**
- ④ **Kaizip THERMAL INSULATION.**
Kaizip Glass Fibre Insulating Quilt.
Compressed From 180mm to 165mm
- ⑤ **TOP SHEET**
Kaizip 65/400 Profile
Finish as Specification
- ⑥ **GUTTER SYSTEM**
Aluminium Single Skin Eaves Gutter Supported Off Steel Rails (By Others), Jointed as Manufacturers Recommendations. Leveling Angles and Bullnose Supports Fixed at 600mm C/C's and Isolated as Necessary
- ⑦ **EAVES COMPONENTS**
Extruded Aluminium Eaves Drip Angle Riwetted to Sheets At Max 400mm C/C's c/w Profiled Foam Filler Block

Revision	Drawn	CHKD	Date	Description
----------	-------	------	------	-------------



Kaizip Ltd
Haydock Lane, Haydock, St. Helens
MERSEYSIDE, WA11 9TY
Tel: 01942 295 500
Fax: 01942 295 508

This drawing is copyright and is issued on the express condition that it is not to be copied or disclosed by or to any unauthorised person or firms without prior consent in writing from Kaizip.

Project:

Kaizip Standard Details

Client:

Kaizip Ltd

Title:

Bullnose Fascia and Soffit Detail

Scale:	Date:	Drawn:	Checked:
NTS	19.12.03	AVV	
Dwg No.	RDS-A-1-08	Rev:	C