


Notes

- ① **Kaizip LINER SHEET**
Kaizip Liner TR 35/2005 (Finish Colour Etc TBC)
- ② **Kaizip VAPOUR CONTROL LAYER (V.C.L)**
Kaizip VCL sealed at laps with Kaizip sealant tape
- ③ **HALTER CLIPS**
- ④ **Kaizip THERMAL INSULATION**
Kaizip Glass Fibre Insulating Quilt.
Compressed From 180mm to 165mm
- ⑤ **TOP SHEET**
Kaizip 65/400 Profile
Finish as Specification
- ⑥ **GUTTER SYSTEM**
Membrane Lined Composite Insulated Gutter Laid Level on Rails (By Others), Joined as Manufacturers Recommendations. Levelling Angles and Bullnose Supports Fixed at 600mm C/C's and Isolated as Necessary
- ⑦ **EAVES COMPONENTS**
Extruded Aluminium Eaves Drip Angle Riveted to Sheets At Max 400mm C/C's c/w Profiled Foam Filler Block

Wall construction to achieve minimum U-value of 0.35 W/m² K
Ensure that steelwork outriggers are wrapped with insulation to reduce cold bridge.
Stated calculation results are dependent on components being as shown

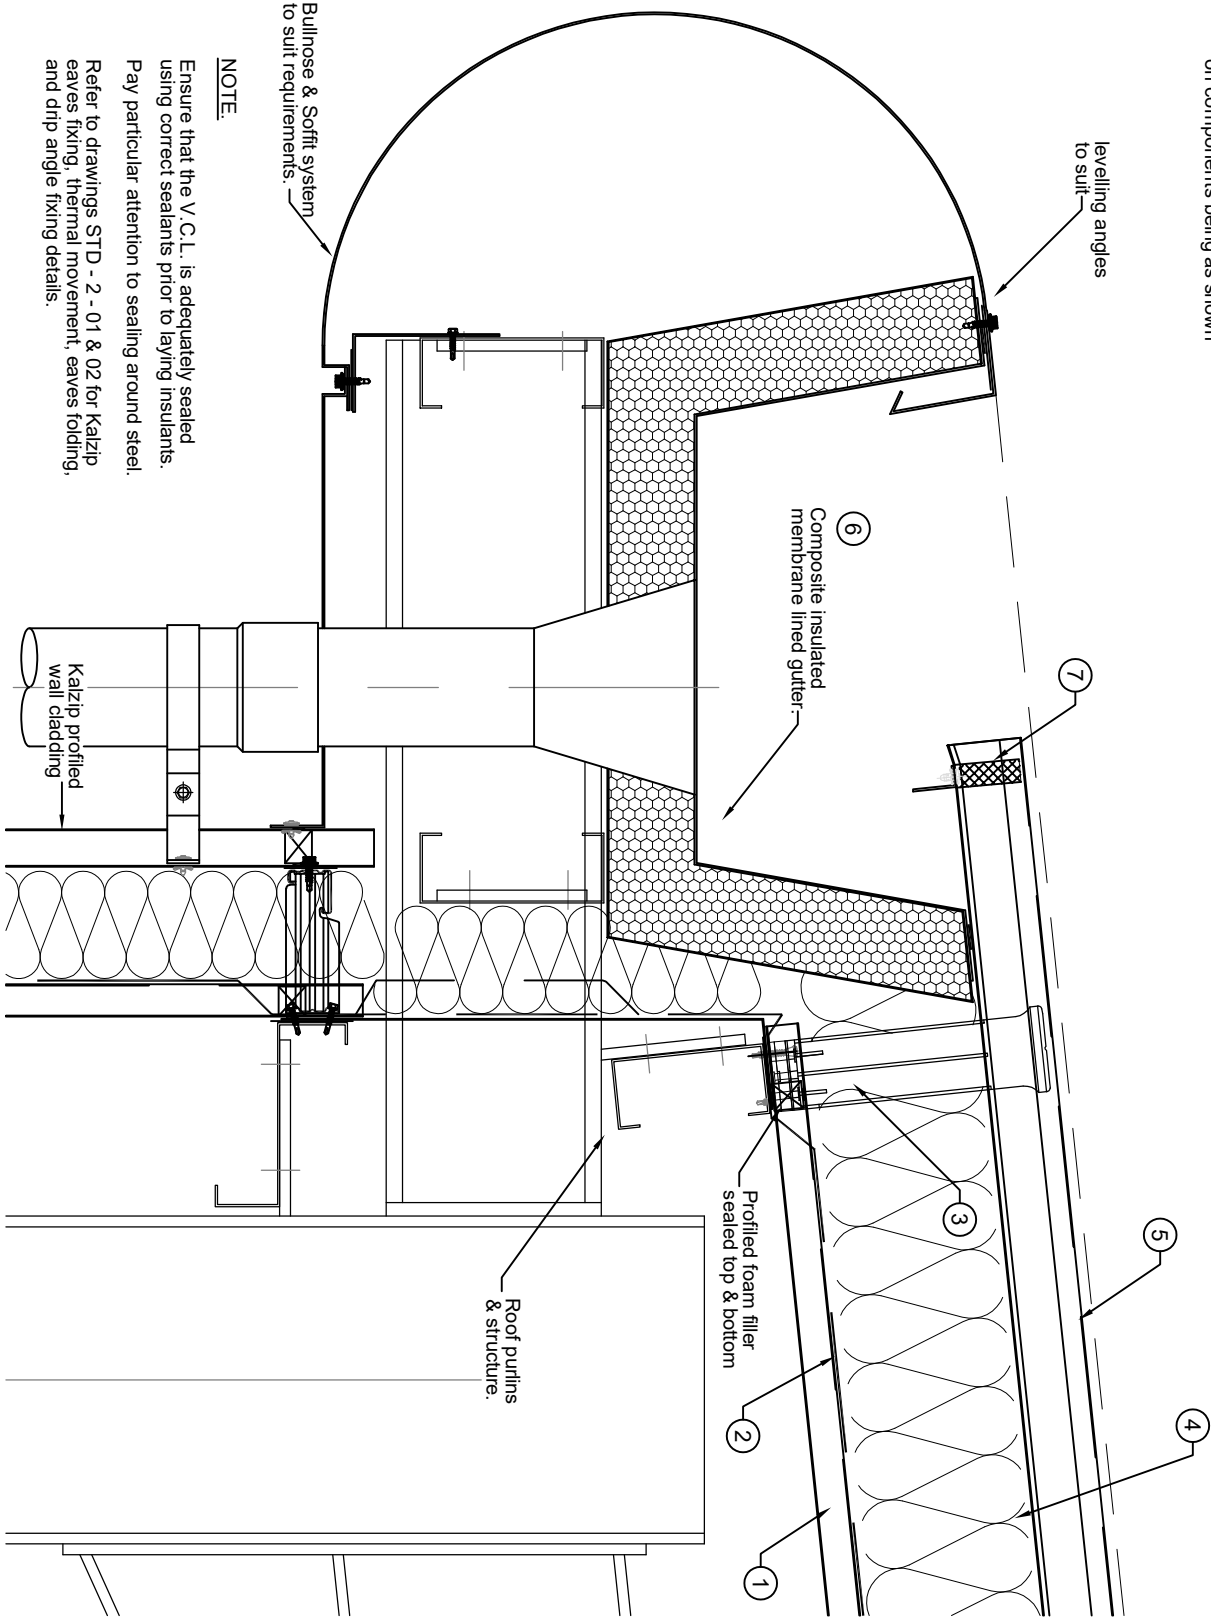

This drawing is copyright and is issued on the express condition that it is not to be copied or disclosed by or to any unauthorised person or firms without prior consent in writing from Kaizip.

Project:

Kaizip Standard Details

Client:

Kaizip Ltd

Title:

Bullnose Fascia and Soffit Detail
Composite Gutter

Scale: NTS Date: 19.12.03 Drawn: AWV Checked:

Dwg No. RDS-A-1-09 Rev: C



Kaizip Ltd
Haydock Lane, Haydock, St. Helens
MERSEYSIDE, WA11 9TY
Tel: 01942 295 500
Fax: 01942 295 508